


**PERMITS REQUIRED**

- ① ABANDON SEPTIC TANK –SEE PROCEDURES BELOW
- ② CONNECTION FROM THE BUILDING TO STUB– LICENSED PIPE LAYER REQUIRED
- ③ NEW INTERNAL PLUMBING – LICENSED MASTER PLUMBER REQUIRED
- ④ ABANDON WELL – HENNEPIN COUNTY (SEE ATTACHED INFORMATION)

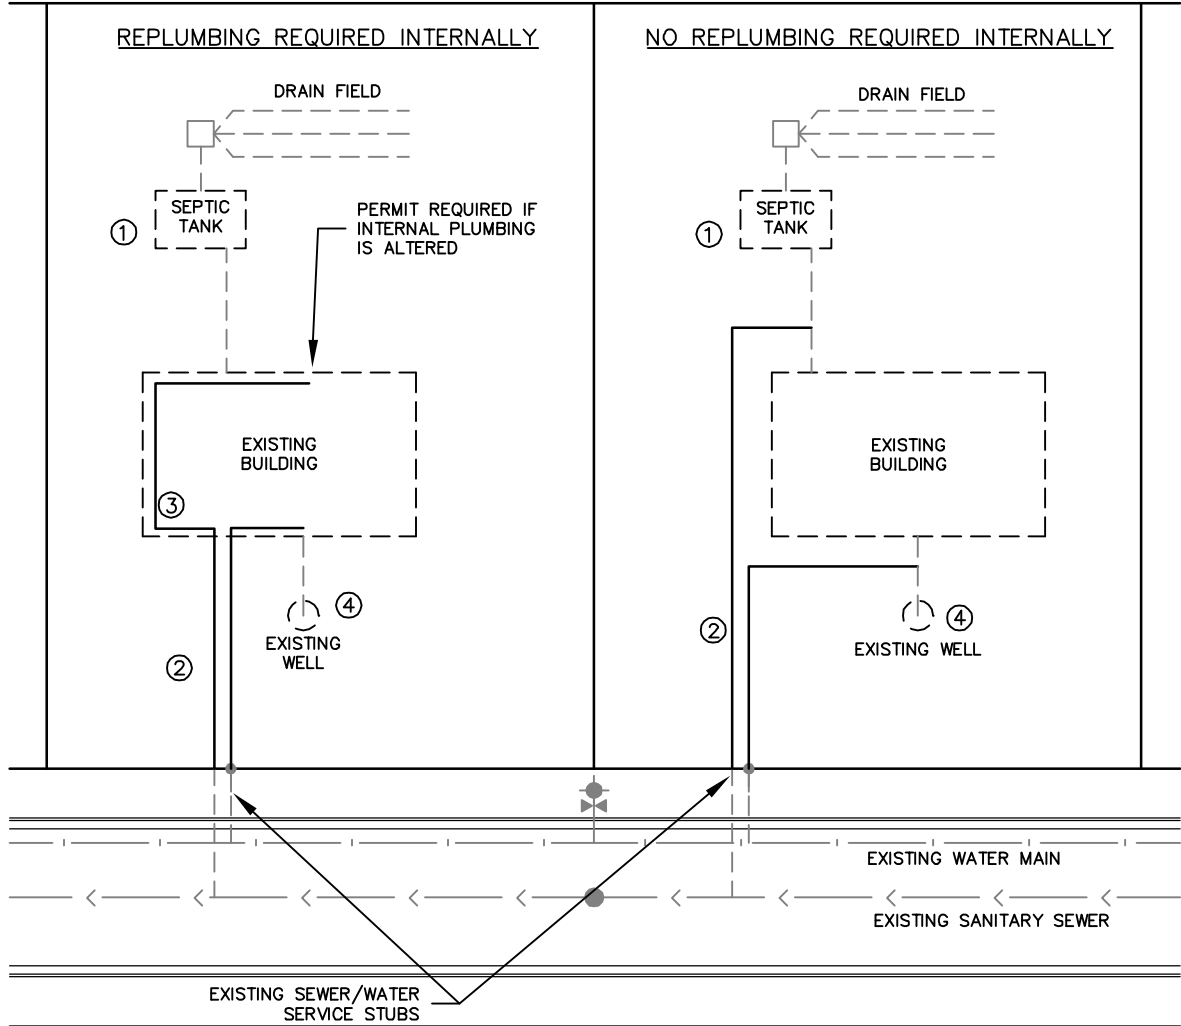

**NOTES**

- 1. GATE VALVE SHALL NOT BE LOCATED IN DRIVEWAY.
- 2. ALL SYSTEMS WITH NO FUTURE INTENT FOR USE MUST BE ABANDONED. ALL SOLIDS AND LIQUIDS MUST BE DISPOSED OF ACCORDINGLY BY A LICENSED MAINTENANCE BUSINESS. ALL ELECTRICAL DEVICES AND DEVICES CONTAINING MERCURY MUST BE REMOVED AND DISPOSED OF ACCORDING TO APPLICABLE REGULATIONS. ABANDONED TANKS OR ANY OTHER UNDERGROUND CAVITIES MUST BE REMOVED OR REMAIN IN PLACE AND CRUSHED WITH THE REMAINING CAVITY FILLED WITH SOIL OR ROCK MATERIAL. ACCESS FOR FUTURE DISCHARGE TO THE SYSTEM MUST BE PERMANENTLY DENIED.
- 3. SANITARY SEWER SERVICE SIZE SHALL BE BASED ON FLOW USAGE.
- 4. WATER SERVICE SIZE SHALL BE BASED ON USAGE/FIRE PROTECTION.
- 5. WATER SERVICE SHALL BE INSTALLED WITH TRACER WIRE.
- 6. COMPLY WITH MINNESOTA DEPARTMENT OF HEALTH SEPARATION REQUIREMENTS.



**STANDARD DETAILS**  
**NON-RESIDENTIAL SEWER AND**  
**WATER SERVICE CONNECTIONS**  
**FROM STUB TO BUILDING**

**DAYTON, MINNESOTA**

Last Revision:  
 MAR. 2008

City Plate No.

**SER-06**