




PERMITS REQUIRED

- ① ABANDON SEPTIC TANK -SEE PROCEDURES BELOW
- ② CONNECTION FROM THE BUILDING TO STUB- LICENSED PIPE LAYER REQUIRED
- ③ NEW INTERNAL PLUMBING - LICENSED MASTER PLUMBER REQUIRED
- ④ ABANDON WELL - HENNEPIN COUNTY (SEE ATTACHED INFORMATION)

REPLUMBING REQUIRED INTERNALLY

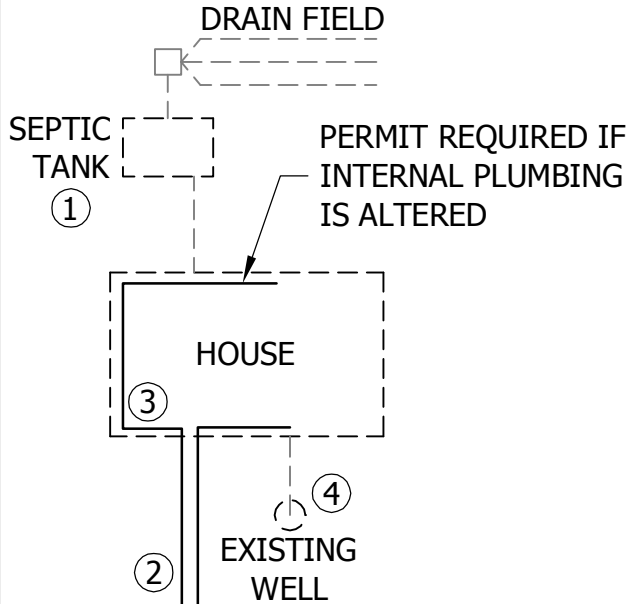

NO REPLUMBING REQUIRED INTERNALLY

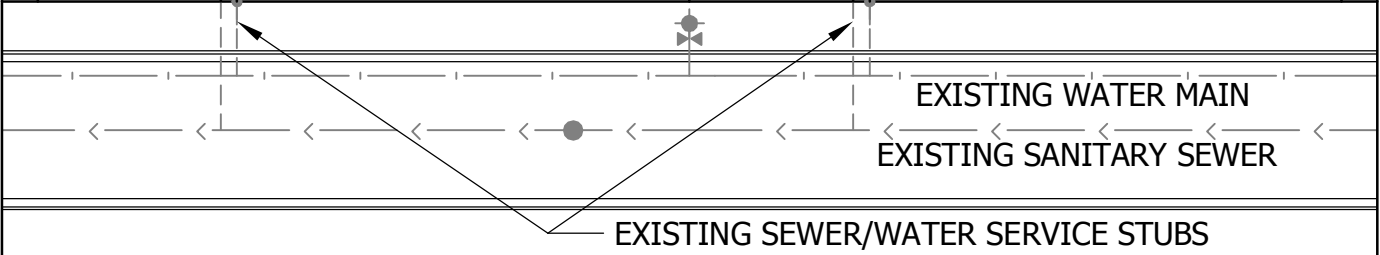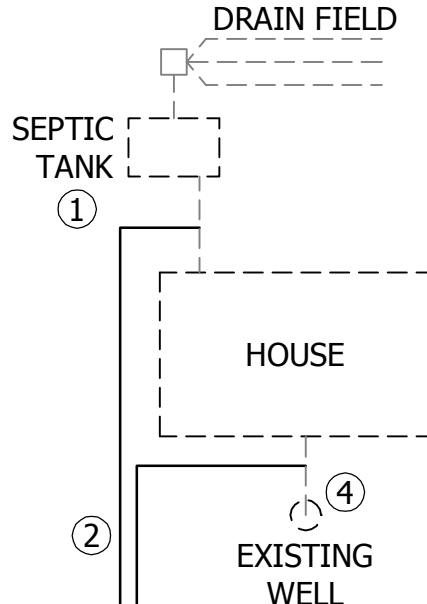

NOTES

- 1. CURB BOX SHALL NOT BE LOCATED IN DRIVEWAY.
- 2. ALL SYSTEMS WITH NO FUTURE INTENT FOR USE MUST BE ABANDONED. ALL SOLIDS AND LIQUIDS MUST BE DISPOSED OF ACCORDINGLY BY A LICENSED MAINTENANCE BUSINESS. ALL ELECTRICAL DEVICES AND DEVICES CONTAINING MERCURY MUST BE REMOVED AND DISPOSED OF ACCORDING TO APPLICABLE REGULATIONS. ABANDONED TANKS OR ANY OTHER UNDERGROUND CAVITIES MUST BE REMOVED OR REMAIN IN PLACE AND CRUSHED WITH THE REMAINING CAVITY FILLED WITH SOIL OR ROCK MATERIAL. ACCESS FOR FUTURE DISCHARGE TO THE SYSTEM MUST BE PERMANENTLY DENIED.
- 3. SANITARY SEWER SERVICE SHALL BE 4" PVC SCHEDULE 40.
- 4. WATER SERVICE SHALL BE INSTALLED WITH TRACER WIRE.
- 5. COMPLY WITH MINNESOTA DEPARTMENT OF HEALTH SEPARATION REQUIREMENTS.



RESIDENTIAL SEWER AND WATER SERVICE CONNECTIONS FROM STUB TO HOUSE

LAST REVISION:
MAR. 2008

PLATE NO.
SER-05